

CTVista®+ Software Helps Brewery Troubleshoot Evaporative Condenser Temperature Spike



BACKGROUND

A large brewery in the western US set up a brand-new ammonia cooling process at their facility. The ChemTreat team implemented CTVista®+ water management software to connect data inputs from ChemTreat controllers across the brewery's eight evaporative condensers and a cooling tower to monitor inhibitor feed, conductivity, pH, temperature, and flow. The controllers send alarms to the local ChemTreat team via our CTVista®+ software whenever monitored parameters are out of range.

On a Saturday evening, the ChemTreat representative received an alarm from the CTVista®+ software, alerting a sudden temperature spike from the usual 65°F to 95°F in all eight condensers.



SOLUTION

The ChemTreat representative immediately informed facility management of the temperature increase. Although on-site staff had detected the issue independently of the alarm, because this was a brand-new ammonia cooling process, the communication process had not been well-defined.

Plant staff explained that communication had been lost with one of the evaporative condensers because a communications breaker had been tripped.


Thanks to the controller alarms and CTVista®+ data collection, ChemTreat was able to keep management informed so the customer could quickly determine a course of action.



RESULTS

The communications breaker was increased from 1.0 to 3.0 amperes to resolve the issue.

This problem could have caused a plant shutdown if it was not spotted and resolved quickly. Thanks to the alert the ChemTreat team received from CTVista®, facility management was made aware of the problem and able to troubleshoot and put preventative measures in place.

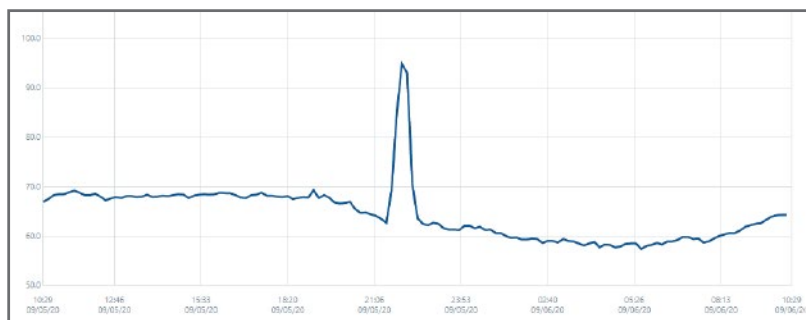

Trend chart showing the temperature spike on one of eight condensers